



Nevada County Building
 Department
 950 Maidu Avenue
 Nevada City, CA 95959
 (530) 265-1222
www.mynevadacounty.com

Grass Valley Building
 Division
 125 East Main Street
 Grass Valley, CA 95945
 (530) 274-4344
www.cityofgrassvalley.com

"Partnering to Improve Consistency & Customer Service"

GAS LINE SCHEMATIC

TO BE PREPARED BY A LICENSED PLUMBER OR ENGINEER

SITE ADDRESS: _____ PERMIT #: _____

GAS TYPE: PROPANE NATURAL GAS TOTAL BTU'S _____

SPECIFIC GRAVITY: _____ WATER COLUMN: _____

TOTAL DEVELOPED LENGTH (LONGEST RUN): _____

DESIGNER: _____

NAME: _____


BUSINESS NAME: _____ LICENSE#: _____

SIGNATURE: _____ DATE: _____

SHOW LINE DIAGRAM BELOW:

EXAMPLE ON BACK

TYPICAL GAS LINE SCHEMATIC

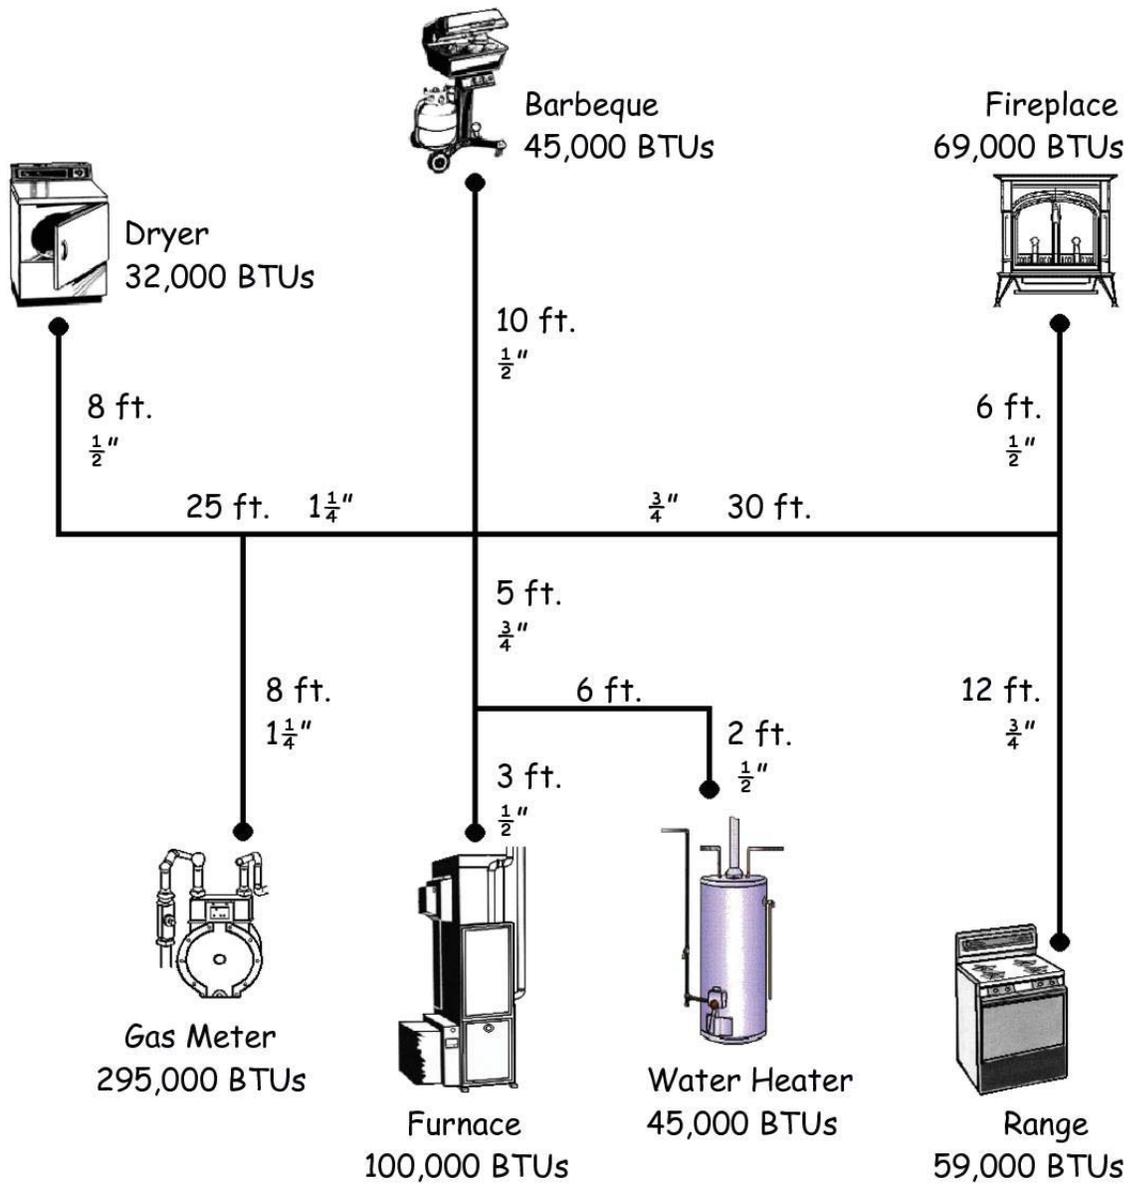

Exception: Sizing shall be permitted to be based upon established load diversity factors. [NFPA 54:5.3.2.3]

**TABLE 1208.3.1
APPROXIMATE GAS INPUT FOR
TYPICAL APPLIANCES
[NFPA 54: TABLE A.5.3.2.1]**

| APPLIANCE | INPUT (Btu/h approx.) |
|---|--------------------------|
| Space Heating Units | |
| Warm air furnace | |
| Single family | 100 000 |
| Multifamily, per unit | 60 000 |
| Hydronic boiler | |
| Single family | 100 000 |
| Multifamily, per unit | 60 000 |
| Space and Water Heating Units | |
| Hydronic boiler | |
| Single-family | 120 000 |
| Multifamily, per unit | 75 000 |
| Water Heating Appliances | |
| Water heater, automatic storage | |
| 30 to 40 gallon tank | 35 000 |
| Water heater, automatic storage | |
| 50 gallon tank | 50 000 |
| Water heater, automatic instantaneous | |
| Capacity at 2 gallons per minute | 142 800 |
| Capacity at 4 gallons per minute | 285 000 |
| Capacity at 6 gallons per minute | 428 400 |
| Water heater, domestic, circulating or side-arm | 35 000 |
| Cooking Appliances | |
| Range, freestanding, domestic | 65 000 |
| Built-in oven or broiler unit, domestic | 25 000 |
| Built-in top unit, domestic | 40 000 |
| Other Appliances | |
| Refrigerator | 3000 |
| Clothes dryer, Type 1 (domestic) | 35 000 |
| Gas fireplace direct-vent | 40 000 |
| Gas log | 80 000 |
| Barbecue | 40 000 |
| Gaslight | 2500 |

For SI units: 1000 British thermal units per hour = 0.293 kW

1208.3.2 Sizing Methods. Gas piping shall be sized in accordance with one of the following:

- (1) Pipe sizing tables or sizing equations in this chapter.
- (2) Sizing tables included in a listed piping system manufacturer's installation instructions.
- (3) Engineering methods. [NFPA 54:5.3.3]

1208.3.3 Allowable Pressure Drop. The design pressure loss in a piping system from the point of delivery to

the inlet connection of all appliances served shall be such that the supply pressure at each appliance inlet is greater than or equal to the minimum pressure required by the appliance. [NFPA 54:5.3.4]

1208.4 Maximum Operating Pressure in Buildings.

The maximum operating pressure for any piping systems located inside buildings shall not exceed 5 psi (34 kPa) unless one or more of the following conditions are met:

- (1) The piping joints are welded or brazed.
- (2) The piping is joined by fittings listed to ANSI LC 4/CSA 6.32 and installed according to the manufacturer's installation instructions.
- (3) The piping joints are flanged and all pipe-to-flange connections are made by welding or brazing.
- (4) The piping is located in a ventilated chase or otherwise enclosed for protection against accidental gas accumulation.
- (5) The piping is located inside buildings or separate areas of buildings used exclusively for one of the following:
 - (a) Industrial processing or heating
 - (b) Research
 - (c) Warehousing
 - (d) Boiler or mechanical rooms
- (6) The piping is a temporary installation for buildings under construction.
- (7) The piping serves appliances or equipment used for agricultural purposes.
- (8) The piping system is an LP-Gas piping system with an operating pressure greater than 20 psi (138 kPa) and complies with NFPA 58. [NFPA 54:5.4.4]

1208.4.1 LP-Gas Systems Operating Below -5°F

(-21°C). LP-Gas systems designed to operate below -5°F (-21°C) or with butane or a propane-butane mix shall be designed to either accommodate liquid LP-Gas or to prevent LP-Gas vapor from condensing back into a liquid. [NFPA 54:5.4.5]

1208.5 Acceptable Piping Materials and Joining Methods.

Materials used for piping systems shall comply with the requirements of Section 1208.5.1 through Section 1208.5.6.3. {NFPA 54:5.5.1.1}

1208.5.1 Used Materials. Pipe, fittings, valves, or other materials shall not be used again unless they are free of foreign materials and have been ascertained to be adequate for the service intended. [NFPA 54:5.5.1.2]


1208.5.2 Metallic Pipe. Metallic pipe shall be in accordance with the Section 1208.5.2.1 through Section 1208.5.2.4.

1208.5.2.1 Cast Iron. Cast-iron pipe shall not be used. [NFPA 54:5.5.2.1]

1208.5.2.2 Steel, Stainless Steel, and Wrought-Iron Pipe. Steel, stainless steel, and wrought-iron pipe shall be at least Schedule 40 and shall comply

FIGURE 1215.1.1
EXAMPLE ILLUSTRATING USE OF TABLE 1208.3.1 AND TABLE 1215.2(1)

Problem: Determine the required pipe size of each section and outlet of the piping system shown in Figure 1215.1.1. Gas to be used has a specific gravity of 0.60 and 1100 British thermal units (Btu) per cubic foot (0.0114 kW•h/L), delivered at 8 inch water column (2.0 kPa) pressure.

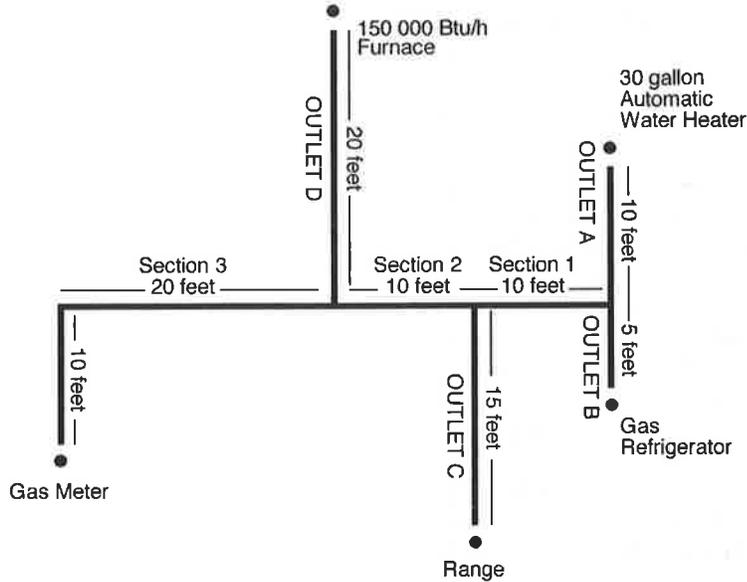

For SI units: 1 foot = 304.8 mm, 1 gallon = 3.785 L, 1000 British thermal units per hour = 0.293 kW, 1 cubic foot per hour = 0.0283 m³/h

Solution:

- (1) Maximum gas demand of Outlet A —
 32 cubic feet per hour (0.91 m³/h) (from Table 1208.3.1).
 Maximum gas demand of Outlet B —
 3 cubic feet per hour (0.08 m³/h) (from Table 1208.3.1).
 Maximum gas demand of Outlet C —
 59 cubic feet per hour (1.67 m³/h) (from Table 1208.3.1).
 Maximum gas demand of Outlet D —
 136 cubic feet per hour (3.85 m³/h) [150 000 Btu/hour (44 kW) divided by 1100 Btu per cubic foot (0.0114 kW•h/L)].
- (2) The length of pipe from the gas meter to the most remote outlet (Outlet A) is 60 feet (18 288 mm).
- (3) Using the length in feet column row marked 60 feet (18 288 mm) in Table 1215.2(1):
 Outlet A, supplying 32 cubic feet per hour (0.91 m³/h), requires ½ of an inch (15 mm) pipe.
 Section 1, supplying Outlets A and B, or 35 cubic feet per hour (0.99 m³/h) requires ½ of an inch (15 mm) pipe.
 Section 2, supplying Outlets A, B, and C, or 94 cubic feet per hour (2.66 m³/h) requires ¾ of an inch (20 mm) pipe.
 Section 3, supplying Outlets A, B, C, and D, or 230 cubic feet per hour (6.51 m³/h), requires 1 inch (25 mm) pipe.
- (4) Using the column marked 60 feet (18 288 mm) in Table 1215.2(1):
 Outlet B supplying 3 cubic feet per hour (0.08 m³/h), requires ½ of an inch (15 mm) pipe.
 Outlet C, supplying 59 cubic feet per hour (1.67 m³/h), requires ½ of an inch (15 mm) pipe.
- (5) Using the column marked 60 feet (18 288 mm) in Table 1215.2(1):
 Outlet D, supplying 136 cubic feet per hour (3.85 m³/h), requires ¾ of an inch (20 mm) pipe.

TABLE 1215.2(1)
SCHEDULE 40 METALLIC PIPE [NFPA 54: TABLE 6.2.1(b)]^{1, 2}

| | | | | | | | | | | | | | | GAS: NATURAL | | | | | | | | | | | | | | |
|---------------|--|-------|-------|-------|-------|-------|-------|--------|--------|--------|--------|---------|---------|---------------------------------|--|--|--|--|--|--|--|--|--|--|--|--|--|--|
| | | | | | | | | | | | | | | INLET PRESSURE: LESS THAN 2 psi | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | PRESSURE DROP: 0.5 in. w.c. | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | SPECIFIC GRAVITY: 0.60 | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | PIPE SIZE (inch) | | | | | | | | | | | | | | |
| NOMINAL: | ½ | ¾ | 1 | 1¼ | 1½ | 2 | 2½ | 3 | 4 | 5 | 6 | 8 | 10 | 12 | | | | | | | | | | | | | | |
| ACTUAL ID: | 0.622 | 0.824 | 1.049 | 1.380 | 1.610 | 2.067 | 2.469 | 3.068 | 4.026 | 5.047 | 6.065 | 7.981 | 10.020 | 11.938 | | | | | | | | | | | | | | |
| LENGTH (feet) | CAPACITY IN CUBIC FEET OF GAS PER HOUR | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 | 172 | 360 | 678 | 1390 | 2090 | 4020 | 6400 | 11 300 | 23 100 | 41 800 | 67 600 | 139 000 | 252 000 | 399 000 | | | | | | | | | | | | | | |
| 20 | 118 | 247 | 466 | 957 | 1430 | 2760 | 4400 | 7780 | 15 900 | 28 700 | 46 500 | 95 500 | 173 000 | 275 000 | | | | | | | | | | | | | | |
| 30 | 95 | 199 | 374 | 768 | 1150 | 2220 | 3530 | 6250 | 12 700 | 23 000 | 37 300 | 76 700 | 139 000 | 220 000 | | | | | | | | | | | | | | |
| 40 | 81 | 170 | 320 | 657 | 985 | 1900 | 3020 | 5350 | 10 900 | 19 700 | 31 900 | 65 600 | 119 000 | 189 000 | | | | | | | | | | | | | | |
| 50 | 72 | 151 | 284 | 583 | 873 | 1680 | 2680 | 4740 | 9660 | 17 500 | 28 300 | 58 200 | 106 000 | 167 000 | | | | | | | | | | | | | | |
| 60 | 65 | 137 | 257 | 528 | 791 | 1520 | 2430 | 4290 | 8760 | 15 800 | 25 600 | 52 700 | 95 700 | 152 000 | | | | | | | | | | | | | | |
| 70 | 60 | 126 | 237 | 486 | 728 | 1400 | 2230 | 3950 | 8050 | 14 600 | 23 600 | 48 500 | 88 100 | 139 000 | | | | | | | | | | | | | | |
| 80 | 56 | 117 | 220 | 452 | 677 | 1300 | 2080 | 3670 | 7490 | 13 600 | 22 000 | 45 100 | 81 900 | 130 000 | | | | | | | | | | | | | | |
| 90 | 52 | 110 | 207 | 424 | 635 | 1220 | 1950 | 3450 | 7030 | 12 700 | 20 600 | 42 300 | 76 900 | 122 000 | | | | | | | | | | | | | | |
| 100 | 50 | 104 | 195 | 400 | 600 | 1160 | 1840 | 3260 | 6640 | 12 000 | 19 500 | 40 000 | 72 600 | 115 000 | | | | | | | | | | | | | | |
| 125 | 44 | 92 | 173 | 355 | 532 | 1020 | 1630 | 2890 | 5890 | 10 600 | 17 200 | 35 400 | 64 300 | 102 000 | | | | | | | | | | | | | | |
| 150 | 40 | 83 | 157 | 322 | 482 | 928 | 1480 | 2610 | 5330 | 9650 | 15 600 | 32 100 | 58 300 | 92 300 | | | | | | | | | | | | | | |
| 175 | 37 | 77 | 144 | 296 | 443 | 854 | 1360 | 2410 | 4910 | 8880 | 14 400 | 29 500 | 53 600 | 84 900 | | | | | | | | | | | | | | |
| 200 | 34 | 71 | 134 | 275 | 412 | 794 | 1270 | 2240 | 4560 | 8260 | 13 400 | 27 500 | 49 900 | 79 000 | | | | | | | | | | | | | | |
| 250 | 30 | 63 | 119 | 244 | 366 | 704 | 1120 | 1980 | 4050 | 7320 | 11 900 | 24 300 | 44 200 | 70 000 | | | | | | | | | | | | | | |
| 300 | 27 | 57 | 108 | 221 | 331 | 638 | 1020 | 1800 | 3670 | 6630 | 10 700 | 22 100 | 40 100 | 63 400 | | | | | | | | | | | | | | |
| 350 | 25 | 53 | 99 | 203 | 305 | 587 | 935 | 1650 | 3370 | 6100 | 9880 | 20 300 | 36 900 | 58 400 | | | | | | | | | | | | | | |
| 400 | 23 | 49 | 92 | 189 | 283 | 546 | 870 | 1540 | 3140 | 5680 | 9190 | 18 900 | 34 300 | 54 300 | | | | | | | | | | | | | | |
| 450 | 22 | 46 | 86 | 177 | 266 | 512 | 816 | 1440 | 2940 | 5330 | 8620 | 17 700 | 32 200 | 50 900 | | | | | | | | | | | | | | |
| 500 | 21 | 43 | 82 | 168 | 251 | 484 | 771 | 1360 | 2780 | 5030 | 8150 | 16 700 | 30 400 | 48 100 | | | | | | | | | | | | | | |
| 550 | 20 | 41 | 78 | 159 | 239 | 459 | 732 | 1290 | 2640 | 4780 | 7740 | 15 900 | 28 900 | 45 700 | | | | | | | | | | | | | | |
| 600 | 19 | 39 | 74 | 152 | 228 | 438 | 699 | 1240 | 2520 | 4560 | 7380 | 15 200 | 27 500 | 43 600 | | | | | | | | | | | | | | |
| 650 | 18 | 38 | 71 | 145 | 218 | 420 | 669 | 1180 | 2410 | 4360 | 7070 | 14 500 | 26 400 | 41 800 | | | | | | | | | | | | | | |
| 700 | 17 | 36 | 68 | 140 | 209 | 403 | 643 | 1140 | 2320 | 4190 | 6790 | 14 000 | 25 300 | 40 100 | | | | | | | | | | | | | | |
| 750 | 17 | 35 | 66 | 135 | 202 | 389 | 619 | 1090 | 2230 | 4040 | 6540 | 13 400 | 24 400 | 38 600 | | | | | | | | | | | | | | |
| 800 | 16 | 34 | 63 | 130 | 195 | 375 | 598 | 1060 | 2160 | 3900 | 6320 | 13 000 | 23 600 | 37 300 | | | | | | | | | | | | | | |
| 850 | 16 | 33 | 61 | 126 | 189 | 363 | 579 | 1020 | 2090 | 3780 | 6110 | 12 600 | 22 800 | 36 100 | | | | | | | | | | | | | | |
| 900 | 15 | 32 | 59 | 122 | 183 | 352 | 561 | 992 | 2020 | 3660 | 5930 | 12 200 | 22 100 | 35 000 | | | | | | | | | | | | | | |
| 950 | 15 | 31 | 58 | 118 | 178 | 342 | 545 | 963 | 1960 | 3550 | 5760 | 11 800 | 21 500 | 34 000 | | | | | | | | | | | | | | |
| 1000 | 14 | 30 | 56 | 115 | 173 | 333 | 530 | 937 | 1910 | 3460 | 5600 | 11 500 | 20 900 | 33 100 | | | | | | | | | | | | | | |
| 1100 | 14 | 28 | 53 | 109 | 164 | 316 | 503 | 890 | 1810 | 3280 | 5320 | 10 900 | 19 800 | 31 400 | | | | | | | | | | | | | | |
| 1200 | 13 | 27 | 51 | 104 | 156 | 301 | 480 | 849 | 1730 | 3130 | 5070 | 10 400 | 18 900 | 30 000 | | | | | | | | | | | | | | |
| 1300 | 12 | 26 | 49 | 100 | 150 | 289 | 460 | 813 | 1660 | 3000 | 4860 | 9980 | 18 100 | 28 700 | | | | | | | | | | | | | | |
| 1400 | 12 | 25 | 47 | 96 | 144 | 277 | 442 | 781 | 1590 | 2880 | 4670 | 9590 | 17 400 | 27 600 | | | | | | | | | | | | | | |
| 1500 | 11 | 24 | 45 | 93 | 139 | 267 | 426 | 752 | 1530 | 2780 | 4500 | 9240 | 16 800 | 26 600 | | | | | | | | | | | | | | |
| 1600 | 11 | 23 | 44 | 89 | 134 | 258 | 411 | 727 | 1480 | 2680 | 4340 | 8920 | 16 200 | 25 600 | | | | | | | | | | | | | | |
| 1700 | 11 | 22 | 42 | 86 | 130 | 250 | 398 | 703 | 1430 | 2590 | 4200 | 8630 | 15 700 | 24 800 | | | | | | | | | | | | | | |
| 1800 | 10 | 22 | 41 | 84 | 126 | 242 | 386 | 682 | 1390 | 2520 | 4070 | 8370 | 15 200 | 24 100 | | | | | | | | | | | | | | |
| 1900 | 10 | 21 | 40 | 81 | 122 | 235 | 375 | 662 | 1350 | 2440 | 3960 | 8130 | 14 800 | 23 400 | | | | | | | | | | | | | | |
| 2000 | NA | 20 | 39 | 79 | 119 | 229 | 364 | 644 | 1310 | 2380 | 3850 | 7910 | 14 400 | 22 700 | | | | | | | | | | | | | | |

For SI units: 1 inch = 25 mm, 1 foot = 304.8 mm, 1 cubic foot per hour = 0.0283 m³/h, 1 pound-force per square inch = 6.8947 kPa, 1 inch water column = 0.249 kPa

Notes:

¹ Table entries are rounded to 3 significant digits.

² NA means a flow of less than 10 ft³/h (0.283 m³/h).

FUEL GAS PIPING

TABLE 1215.2(27)
SCHEDULE 40 METALLIC PIPE [NFPA 54: TABLE 6.3.1(d)]*

| | | | | | | | | | | GAS: UNDILUTED PROPANE | |
|--|---------------------------------------|-------|-------|-------|-------|-------|--------|--------|--------|-------------------------------|--|
| | | | | | | | | | | INLET PRESSURE: 11.0 in. w.c. | |
| | | | | | | | | | | PRESSURE DROP: 0.5 in. w.c. | |
| | | | | | | | | | | SPECIFIC GRAVITY: 1.50 | |
| INTENDED USE: PIPE SIZING BETWEEN SINGLE- OR SECOND-STAGE (LOW-PRESSURE) REGULATOR AND APPLIANCE | | | | | | | | | | | |
| PIPE SIZE (inch) | | | | | | | | | | | |
| NOMINAL INSIDE: | ½ | ¾ | 1 | 1¼ | 1½ | 2 | 2½ | 3 | 4 | | |
| ACTUAL: | 0.622 | 0.824 | 1.049 | 1.380 | 1.610 | 2.067 | 2.469 | 3.068 | 4.026 | | |
| LENGTH (feet) | CAPACITY IN THOUSANDS OF BTU PER HOUR | | | | | | | | | | |
| 10 | 291 | 608 | 1150 | 2350 | 3520 | 6790 | 10 800 | 19 100 | 39 000 | | |
| 20 | 200 | 418 | 787 | 1620 | 2420 | 4660 | 7430 | 13 100 | 26 800 | | |
| 30 | 160 | 336 | 632 | 1300 | 1940 | 3750 | 5970 | 10 600 | 21 500 | | |
| 40 | 137 | 287 | 541 | 1110 | 1660 | 3210 | 5110 | 9030 | 18 400 | | |
| 50 | 122 | 255 | 480 | 985 | 1480 | 2840 | 4530 | 8000 | 16 300 | | |
| 60 | 110 | 231 | 434 | 892 | 1340 | 2570 | 4100 | 7250 | 14 800 | | |
| 70 | 101 | 212 | 400 | 821 | 1230 | 2370 | 3770 | 6670 | 13 600 | | |
| 80 | 94 | 197 | 372 | 763 | 1140 | 2200 | 3510 | 6210 | 12 700 | | |
| 90 | 89 | 185 | 349 | 716 | 1070 | 2070 | 3290 | 5820 | 11 900 | | |
| 100 | 84 | 175 | 330 | 677 | 1010 | 1950 | 3110 | 5500 | 11 200 | | |
| 125 | 74 | 155 | 292 | 600 | 899 | 1730 | 2760 | 4880 | 9950 | | |
| 150 | 67 | 140 | 265 | 543 | 814 | 1570 | 2500 | 4420 | 9010 | | |
| 175 | 62 | 129 | 243 | 500 | 749 | 1440 | 2300 | 4060 | 8290 | | |
| 200 | 58 | 120 | 227 | 465 | 697 | 1340 | 2140 | 3780 | 7710 | | |
| 250 | 51 | 107 | 201 | 412 | 618 | 1190 | 1900 | 3350 | 6840 | | |
| 300 | 46 | 97 | 182 | 373 | 560 | 1080 | 1720 | 3040 | 6190 | | |
| 350 | 42 | 89 | 167 | 344 | 515 | 991 | 1580 | 2790 | 5700 | | |
| 400 | 40 | 83 | 156 | 320 | 479 | 922 | 1470 | 2600 | 5300 | | |
| 450 | 37 | 78 | 146 | 300 | 449 | 865 | 1380 | 2440 | 4970 | | |
| 500 | 35 | 73 | 138 | 283 | 424 | 817 | 1300 | 2300 | 4700 | | |
| 550 | 33 | 70 | 131 | 269 | 403 | 776 | 1240 | 2190 | 4460 | | |
| 600 | 32 | 66 | 125 | 257 | 385 | 741 | 1180 | 2090 | 4260 | | |
| 650 | 30 | 64 | 120 | 246 | 368 | 709 | 1130 | 2000 | 4080 | | |
| 700 | 29 | 61 | 115 | 236 | 354 | 681 | 1090 | 1920 | 3920 | | |
| 750 | 28 | 59 | 111 | 227 | 341 | 656 | 1050 | 1850 | 3770 | | |
| 800 | 27 | 57 | 107 | 220 | 329 | 634 | 1010 | 1790 | 3640 | | |
| 850 | 26 | 55 | 104 | 213 | 319 | 613 | 978 | 1730 | 3530 | | |
| 900 | 25 | 53 | 100 | 206 | 309 | 595 | 948 | 1680 | 3420 | | |
| 950 | 25 | 52 | 97 | 200 | 300 | 578 | 921 | 1630 | 3320 | | |
| 1000 | 24 | 50 | 95 | 195 | 292 | 562 | 895 | 1580 | 3230 | | |
| 1100 | 23 | 48 | 90 | 185 | 277 | 534 | 850 | 1500 | 3070 | | |
| 1200 | 22 | 46 | 86 | 176 | 264 | 509 | 811 | 1430 | 2930 | | |
| 1300 | 21 | 44 | 82 | 169 | 253 | 487 | 777 | 1370 | 2800 | | |
| 1400 | 20 | 42 | 79 | 162 | 243 | 468 | 746 | 1320 | 2690 | | |
| 1500 | 19 | 40 | 76 | 156 | 234 | 451 | 719 | 1270 | 2590 | | |
| 1600 | 19 | 39 | 74 | 151 | 226 | 436 | 694 | 1230 | 2500 | | |
| 1700 | 18 | 38 | 71 | 146 | 219 | 422 | 672 | 1190 | 2420 | | |
| 1800 | 18 | 37 | 69 | 142 | 212 | 409 | 652 | 1150 | 2350 | | |
| 1900 | 17 | 36 | 67 | 138 | 206 | 397 | 633 | 1120 | 2280 | | |
| 2000 | 17 | 35 | 65 | 134 | 200 | 386 | 615 | 1090 | 2220 | | |

For SI units: 1 inch = 25 mm, 1 foot = 304.8 mm, 1000 British thermal units per hour = 0.293 kW, 1 inch water column = 0.249 kPa

* Table entries are rounded to 3 significant digits.